

**1999 International Ash Utilization Symposium  
Commercial Ash Processing – a User's Perspective**

**SOUTH CAROLINA ELECTRIC & GAS  
SUCCESSFUL APPLICATION OF  
CARBON BURN-OUT  
at the WATEREE STATION**

**W.T. (Ted) Frady<sup>1</sup>, James G. Keppeler<sup>2</sup>, and Jimmy C. Knowles<sup>3</sup>**

<sup>1</sup>South Carolina Electric & Gas Co. 111 Research Drive, Columbia, South Carolina 29203 :

<sup>2</sup>Progress Materials, Inc., One Progress Plaza, St. Petersburg, Florida 33701; <sup>3</sup>Southeastern Fly Ash Co., Inc., 2999 Sunset Boulevard, Suite 101, West Columbia, South Carolina 29169

**ABSTRACT**

Carbon Burn-Out (CBO) combusts residual carbon in fly ash, producing a very consistent, low carbon, high-quality pozzolan. The process is continuous and is fueled solely by the residual carbon. Heat is recovered and sent back to the power plant that originally produced the high-carbon fly ash. The CBO process is an improvement on bubbling fluid bed technology.

Progress Materials, Inc. developed this technology with support from EPRI and EPRI members. A one-tph CBO pilot plant was constructed and continues to operate on a wide variety of ash sources. Data gathered at this plant during test programs provides design parameters for full-scale CBO plants. Extensive concrete testing has been and continues to be undertaken in order to demonstrate the superior characteristics of very low-carbon Class F fly ash from Carbon Burn-Out.

In 1997, South Carolina Electric & Gas contracted with Progress Materials to provide a Carbon Burn-Out facility at Wateree Station. Initial site work began in December 1997 on a CBO plant designed to process 180,000 tpy of ash. Start-up activities began in mid-1998, and commercial operations began in early 1999.

An important feature of Carbon Burn-Out is heat recovery from the residual carbon's combustion. Heat is recovered from both the flue gas and the hot product ash. This recovered heat is returned to Wateree Station by heating a portion of the power plant's condensate stream. This portion of the condensate stream bypasses two existing feedwater heaters, thereby reducing the amount of extraction stream required, which in turn increases the quantity of steam available to the turbine-generator.

This paper presents information about the design, construction and operation of the Wateree Carbon Burn-Out plant, which has, as of this paper's drafting date, produced and shipped over 60,000 tons of premium fly ash since coming on line in early 1999.

## BACKGROUND

South Carolina Electric & Gas (SCE&G) and Southeastern Fly Ash Co. (SEFA) have for many years operated an aggressive coal combustion products (CCP) utilization program in a successful effort to reduce operating costs and costs to customers. As part of this CCP program, a significant marketing effort was devoted to promote widespread use of SCE&G fly ash in concrete. By the early 90's, this marketing effort, coupled with a reasonable supply of ash, led to a market that would willingly accept essentially all concrete-quality fly ash that the several SCE&G coal-fired stations produced. However, the sources' ash carbon content was often marginal at best and non-saleable to the concrete market at worst. In addition, SCE&G and SEFA recognized that changes in combustion conditions designed to meet Low NO<sub>x</sub> regulations would lead to a further diminishment in fly ash quality. As quality was already marginal at several stations, further diminishment would essentially shut this fly ash out of the local concrete market, which was strong and growing. SCE&G determined to avoid that outcome, and undertook an extensive review of ash beneficiation technologies. Carbon Burn-Out was subsequently selected for installation at the Wateree Station, a two-unit, 772 MW plant southeast of Columbia, SC.

## PILOT TESTING

In 1997, fifty tons of Wateree high-carbon fly ash were processed in the one tph CBO pilot plant. Data acquired during the test program on the Wateree ash provided the major design parameters for the full-scale Wateree plant. These data included optimal fluidization velocities, combustion rates, appropriate temperature regimes, and heat exchange coefficients. Additional samples from each of the coal-fired stations proposed as raw feed for the Wateree CBO plant were processed through the bench model to varying LOI levels in order for SEFA to evaluate a range of CBO-processed final LOI's.

The processed ash LOI was less than 2%. This material was shipped to Southeastern Fly Ash Company (SEFA), SCE&G's ash marketer, for extensive laboratory tests and ready-mix field trials. Results demonstrated that concrete mixes made with CBO fly ash replacing varying percentages of Portland cement had nearly identical plastic and hardened characteristics to control mixes containing only cement. In short, the CBO fly ash provided significant benefits to the concrete mixes without undesirable 'side effects'. Determining the air entraining characteristics of the CBO fly ashes was given special emphasis. Laboratory concrete testing showed that CBO fly ash from all the stations had consistently superior air entraining characteristics at below 2% LOI. Field testing confirmed the laboratory results. Very few CBO fly ash samples were analyzed with LOI values above 2%.


## CBO PLANT DESIGN

The philosophy governing the Wateree CBO plant design includes several important elements:

- maximize recovered heat to the power plant
- include provisions for receiving high-carbon ash from other sources
- minimize Operating and Maintenance (O&M) costs
  - 'utility-grade' equipment
  - inclusive instrumentation
  - sophisticated control system
  - open plant layout for easy access
  - automated ash truck loading system
- maximize market value of Carbon Burn-Out product ash
  - high quality product, consistent quality
    - CBO process control keys off product ash quality, not feed ash LOI
    - Design provides for precise control of variables, immediate feedback
    - Long FBC residence time plus temperature control via cooled product ash provides 'smoothing' effect.
  - Product always available, accessible, traffic not interfering with plant operations
    - Re-route ash truck traffic away from power plant
    - Provide round-the-clock product loading without silo/scale-house attendant
    - Two loading stations, both on scales
    - 15,000 product ash storage to maintain product availability during outages

The process flow at CBO Wateree may be easily summarized:

- high-carbon ash is pneumatically conveyed from silos to the CBO plant
- FD fan provides fluidization and combustion air to CBO fluid bed combustor
- feed ash is metered into the combustor
- carbon combusts on a continuous basis
- material exits CBO combustor at 1350° F
  - product fly ash
  - flue gas
- heat exchange occurs between hot product ash + hot flue gas and condensate from the power plant
  - product ash and flue gas exits at < 300° F
  - heated condensate returns to power plant's feedwater heater system
- product ash is separated from flue gas via cyclone and baghouse
- ID fan maintains entire CBO system at a slight negative pressure, transports product ash through the heat exchanger, and transports cooled, particulate-free flue gas to power plant stack.
- product ash is pneumatically conveyed to the Storage and Load-Out Area

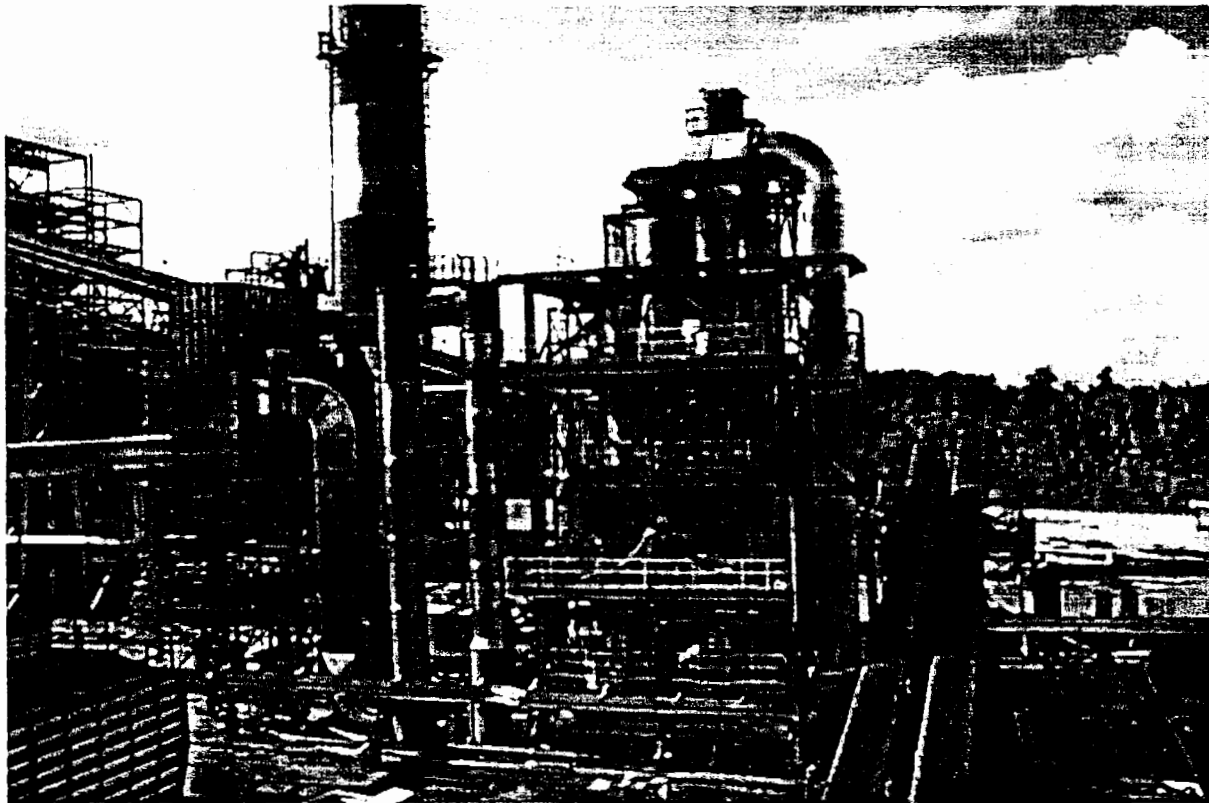

*CBO plant with Wateree stack in background*

Referring to the above photo, the Fluid Bed Combustor is within the tower at right-center. The heat exchanger is the inverted "U" in the center, and the product ash/flue gas separation takes place in the tower at left-center. FD and ID fans are behind the heat exchanger, as is the condensate pump and piping system. The CBO Control Room is just off the right border.

The CBO site at Wateree Station was selected for offering minimal duct runs while maintaining open access to all existing power plant systems. The ash product storage and load-out system is ~ 400' behind the photographer.


The CBO Fluid Bed Combustor (FBC) was designed and fabricated by DB Riley, using PMI's process design parameters. The combustor is a refractory-lined steel box divided into two cells to allow precise process control. The bed consists of only fly ash. For ease of maintenance, nearly all penetrations are through the roof. A start-up burner, fired by No. 2 oil, is in the air plenum below the bed. This burner is ramped down and then shut off once the bed reaches the residual carbon auto-ignition temperature of ~ 900° F.

CBO fluid bed temperature is precisely and automatically controlled by a 'recycle' system metering cooled product ash back to the FBC, where the returning product ash acts as a thermal load. The rate at which this ash is metered into the FBC is determined by the temperature profile in the fluid bed at any point in time -- increasing temperatures signal for more cool ash, declining temperatures signal for less. Pilot plant work first demonstrated this to be a very

effective temperature control technique. It has the added benefit of 'smoothing out' minor variations in ash product LOI. In addition, an Exhaust Gas Recirculation (EGR) system has been added since initial operations commenced and provides significant additional control, especially for enhancing turndown capability.

Environmental permitting for the Wateree CBO project proved quite straightforward. There is no solid or liquid waste stream from the CBO process -- all incoming high-carbon ash exits as a combination of product ash and flue gas. Wateree's heat rate is materially improved, resulting in less coal combusted for a given amount of electricity produced. Therefore overall site emissions are less. Fly ash disposal at Wateree is eliminated. Although not specifically addressed in the permitting process, the regulatory agencies recognize that fly ash use in concrete provides measurable overall CO<sub>2</sub> reductions via cement replacement.

#### FEED ASH STORAGE, PRODUCT ASH STORAGE AND LOADOUT

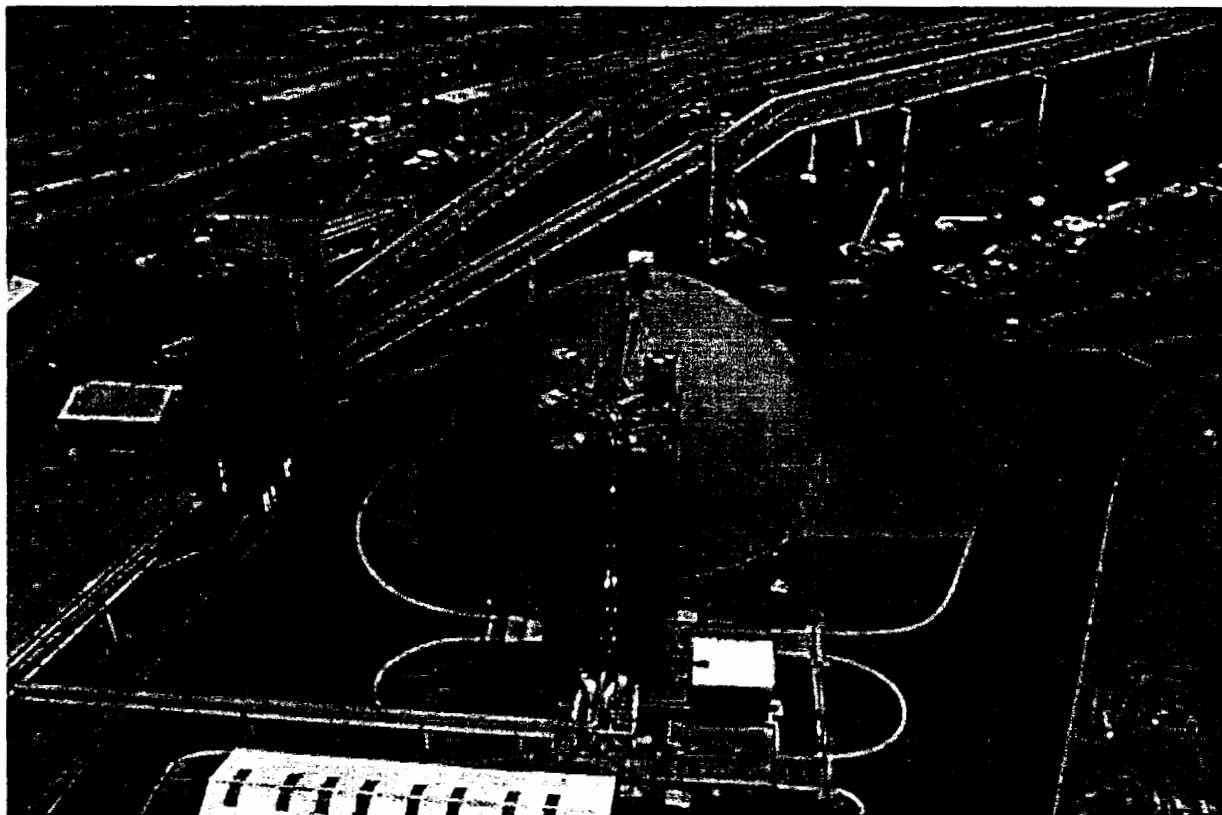

The left side of the photograph above shows two 250 ton silos that receive high-carbon fly ash from other power stations to be processed in CBO Wateree. To date, these have been used to receive ash from SCE&G's McMeekin and Williams Stations, although ash from other stations has been received and processed as well. Ash from these silos is transported pneumatically to the CBO feed silo located directly above the fluid bed. Ash from the two Wateree units is pneumatically fed from an existing silo on the site in the same manner. Note that the ash

receiving and load-out areas were located on the site so as to avoid interference with normal power plant and coal handling operations.

In the photo's foreground are four 250 ton product ash load-out silos, which receive ash pneumatically transported directly from the CBO plant, or from the storage dome, or from both simultaneously. Ash loading and weighing is automated using an entry card system operated by the truck driver. Access is 24 hours per day, seven days a week. This system eliminates the need for operators, and to date has functioned as designed.

The dominant structure in the rear is the new 120' diameter concrete dome. This dome, with its 14,000 ton ash storage capacity, was primarily intended to smooth out seasonal construction fluctuations. However, the enhanced operational flexibility provided by the dome has led to almost daily use, as the market demand for CBO low-carbon ash has exceeded forecasts. The dome features inward-sloping concrete floor over a fly ash structural fill. Aeration slides are mounted on the floor radially from the center. Fluidized ash enters pneumatic transporters at the center of the dome's floor and is transported to the specified load-out silo. Dome fluidization is by segments, with the pattern and timing being automatically performed by the CBO control system signaling motor-operated valves on the aeration manifold. To date, the filling, storing and reclaim systems all have functioned as designed.

#### CBO PLANT OPERATING SUCCESS AND LESSONS LEARNED

Following pre-operational checkout, start-up, and de-bugging, Wateree CBO was placed into commercial operation in early January 1999. To date, the 1350° F operating temperature has proven satisfactory at CBO Wateree for all ash sources processed. Fluidization gas flow has been set ~ 20% below that typically used in the pilot plant so as to reduce the carbon combustion rate.

The primary challenge encountered in early operations was lower-than-expected carbon content in the ash, including ash from off-site sources. The preferred method of fluid bed operations is to meter carbon to the bed at a relatively constant rate, slowing the ash feed for higher LOI sources, and increasing the ash feed for lower LOI sources. In practice, this is accomplished by monitoring the product ash LOI and adjusting the ash feed rate so as to produce a very consistent product. Lower-than-expected carbon in SCE&G ash sources resulted in ash feed and product transport rates significantly above design. The pneumatic transport systems, designed for a nominal 25 tph, functioned satisfactorily up to 40 tph. However, at those rates the available ash was quickly consumed. This led to a CBO Wateree operational plan for the first few months accepting cyclical operation, twelve hours on and twelve hours off. This proved workable but not desirable for the long term. Fly ash is a very good thermal insulator, and the temperature loss over twelve hours was never more than 250° F; however, even this relatively mild thermal cycling should be minimized whenever possible.

Accordingly, a review was initiated to further reduce the carbon combustion rate in the CBO fluid bed, which would 'extend' the amount of readily-available carbon. After considering various concepts, Exhaust Gas Recirculation (EGR) was chosen as the best alternative. This

choice has proven correct. With an EGR system available, a controlled quantity of flue gas downstream of the Induced Draft Fan may be returned to the inlet of the Forced Draft Fan via a duct fitted with a motor-operated damper. This low-O<sub>2</sub> flue gas reduces the CBO combustion rate while at the same time providing proper fluidization of the ash bed. The degree of combustion reduction is determined by the percentage of recirculated flue gas compared to outside air. With EGR, CBO Wateree now enjoys the highly-desirable ability to "follow load", whereby the operator sets the combustion rate to approximately match the rate at which high-carbon ash is being delivered to the various feed silos. In this way continuous operations are assured as much as possible. CBO Wateree has demonstrated the flexibility to produce 2% LOI product from a high-carbon feedstock at operator-determined rates ranging from 20 tph to 40 tph, which is a range not enjoyed by typical fluid beds. For CBO Wateree, this enhancement has proven extremely useful.

Initial operations demonstrated that the Wateree fluid bed provides a carbon combustion rate significantly greater than that observed in the pilot plant and subsequently used for design parameters. Accordingly, the Wateree CBO plant's processing capacity is greater than design by at least 20%. Quantifying the actual upper range of CBO Wateree's combustion capacity has proven difficult because of ash transport system limitations, even though the systems routinely operate at 60% greater than design. The Exhaust Gas Recirculation allows this capacity to be used or not used depending on the amount of feed ash available for processing.

This happy circumstance of having a wide operating range is advantageous only to the extent that feed ash can be made available and that the concrete market will accept increased amounts of product. To address the former, SCE&G and SEFA successfully coordinated efforts to secure additional sources of high-carbon ash so that continuous CBO Wateree operations are possible at rates significantly greater than design. Longer-term, non-SCE&G sources of high carbon ash are being actively considered. On the market side, demand has been very strong because the Carolina concrete market immediately recognized CBO Wateree's ash product quality as being significantly superior to alternative sources.

DB Riley has made modifications to the fluid bed's air distribution plate seal area, designed to better accommodate thermal expansion of this plate during start-up. Several minor enhancements and optimizations have been made to the pneumatic transport systems so that they may comfortably accommodate higher-than-design processing rates.

Recovery of heat from CBO Wateree and application back to the turbine cycle in the power plant has functioned fully as designed. By the end of July, approximately 103,000 million Btu's have been directly recovered to the Wateree units, or roughly the equivalent of 4,100 tons of coal that did not need to be purchased, transported, stored, and combusted for the same amount of electricity produced.

## FLY ASH QUALITY AND MARKET ACCEPTANCE

After the Wateree CBO plant began commercial operation in early 1999, SEFA produced and tested CBO fly ash with varying LOI values to determine the effect of LOI on the air entraining characteristics of Wateree CBO Plant fly ash. Strength data was also obtained.

The Wateree CBO fly ash has the same superior air entraining characteristics demonstrated by the bench model and pilot plant product ash, even at slightly higher LOIs than observed in the preliminary testing. Hardened concrete testing confirms the good strength-producing characteristics expected of Class F fly ash. There is no significant correlation between LOI and the concrete strength results obtained to date.

The Wateree CBO fly ash product is significantly finer in particle size than the high-carbon feed ash. It is very similar to the fineness of low LOI fly ash previously produced by the Wateree units before their Low NO<sub>x</sub> conversion. The Wateree CBO product fly ash shows no signs of agglomeration.

Wateree CBO fly ash has performed very well in the concrete marketplace and is viewed as a premium product. As mentioned earlier, the production capacity of the Wateree CBO plant is 20% greater than designed. However, partly due to the excellent market acceptance of CBO fly ash, SEFA has increased their customer base to accommodate the higher production capacity.

## FUTURE IMPLICATIONS

Wateree Station is now fitted with low NO<sub>x</sub> burners and complies with current regulations. However, further reductions in NO<sub>x</sub> emission limits may well require the application of either Selective Catalytic Reduction (SCR) or Selective Non-Catalytic Reduction (SNCR) technology. Both are known to deposit ammonia onto the fly ash. Even at relatively low levels, ammonia-on-ash presents significant marketing problems and perhaps occupational health and safety issues as well.

Progress Materials has undertaken a CBO pilot plant test program on high-carbon fly ash containing ammonia. This work has demonstrated that, even without process flow changes, product ash from the Carbon Burn-Out fluid bed is both low-carbon and ammonia-free.

## CONCLUSIONS

All challenges encountered during start-up and initial operations were successfully met.

Carbon Burn-Out at Wateree has proven effective and efficient in producing a consistent, very high quality fly ash.

The plant has demonstrated its ability to produce a consistent 2% LOI product from a range of feedstock LOIs and feedstock sources.



The plant can operate successfully on a cyclical operating schedule, if required.

The CBO process flow was successfully enhanced so as to provide a much greater operating range than originally designed.

CBO Wateree enjoys additional capacity, both in the fluid bed and in the ash transport systems, to process significantly more than the design quantity of ash.

Heat recovery back to the power plant functions fully as designed.

CBO Wateree's product ash quality meets or exceeds applicable specifications and the concrete market's requirements.

The product ash storage dome and automated load-out systems function fully as designed.

